

Bri-Ko Engineering, Inc., Spreadsheet designed by: B. Schwartz, PE Structural Analysis Date data input: 2-Mar-23

Calc Sht: EC-1 Mechanical Equipment on Roof Stand Calc

Structural Analysis of roof stand mounted mechanical equipment to Description:

resist wind forces.

FBC 7th Ed. (2020) and ASCE 7-16. Code:

Design Methodology and Load Combinations:

Design Method: LRFD Φ= 0.90 0.9 D + 1.0 W

FBC Ean. 16-6 Load Combos: Wind Forces: based on ASCE 7-16 Eqn. 29.4-1, and FBC 1620.6

Ultimate Design Wind Speed, Vult (3-sec gust): 195 mph Miami Dade Nominal Design Wind Speed, Vasda 151 mph Risk Category: Dir., Topo., Gust Effect: 0.90 1.00 N/A 60 ft Vel. Pres. Exp Coef., Kz: 1.137 Height, h: Exp. Cat.: C

N/A Enclosure Cat.

 $qh = 0.00256 K_z K_{zt} K_d V^2 (lb/ft^2)$ gh= **99.6 psf Velocity Pressure** $F = q_h(GC_r)A_f$ $(GC_r) v_r = (1.5 \text{ ver.}, 1.9 \text{ lat.})$ Fver, Flat: 149.4 psf, | 189.2 psf

Limit States: for illustration purposes only:

	, or							
Select UnitType:	4LIV	Select Model # 4LIV36HP230V1AO						
Number of Leg Frames is 2					\Rightarrow			
Loads, (lbs):	P1= 1402	P2= 548	P3= 561	PD= 127		P3		
Resistance to sliding	g stand post	:			_			
Reqd. Shear/leg =	378 lbs	Nominal S	Shear per leg:	850 lbs	CHECKS OK	1		
Resistance to sliding	lesistance to sliding anchors to support:							
Reqd Sher/anc:	378 lbs	Nom Sh	near per bolt:	900 lbs	CHECKS OK			
		-	•		_			
Resistance to Moment and Uplift: Use Load Combo: 0.90 D + 1.00 W								
Overturn M at stan	d base:	79.0 k-in	Base Pullup:	705 lbs		4		

Overturn M at unit foot: 24.0 k-in Foot Pullup: 799 lbs Nom Pullup Str, 4xConcAnc, Bolt: 5480 lbs 1700 lbs CHECKS OK

Verification of Support Angle:

 $R_2 = 799$ $R_3 = 525$ Forces, lbs: $-R_1 = 423$ $R_4 = 149$ Required Mom.: 4.3 k-in Reqd Section Modulus: 0.229 in³

Use: 3"x3"x1/4" with Sx = 0.547 in³

Unit Integrity: If Required. Only if manufacturer does not state design wind pressure.

Required tension on strap= 817 lbs Strap width, gauge= 1.375 in. Steel Strength= 45 ksi min.

20ga min gauge thickness

Strength of strap= 981 lbs Checks OK

Af2

PD

STDP

- E -

R3

R4.

Shear

SYM

A-1 A-2

A-3

A-4 1/4" A307 Bolt

5/16" A307 Bolt

Af1

R2

R1

GREE DUCTFREE MINI-SPLITS OUTDOOR CONDENSING UNITS

ROOF STAND CONFIGURATION AND ANCHOR SELECTION - WIND LOAD EXAMINATION

ENGINEERING CONFORMANCE ANALYSIS:

THE TABLE SHOWS ROOF STAND AND ANCHOR TYPES FOR VARIOUS MODELS OF HVAC OUTDOOR EQUIPMENT UP TO 3 TONS THAT MEET THE FOLLOWING ANALYSIS: • OVERTURN • SLIDING • ANCHOR PULLOUT AND SHEAR STRENGH • EQUIPMENT INTEGRITY.

TABLE A-2

4LIV - Series	Weight	Length	Width B	Height	Mount	Mount
Model No.	(lbs)	C (in.)	(in.)	A (in.)	E (in.)	F (in.)
4LIV09HP115V1AO	60	26.6	11.2	21.9	12.2	17.9
4LIV12HP115V1AO	60	26.6	11.2	21.9	12.2	17.9
4LIV09HP230V1AO	56	26.6	11.2	21.9	12.2	17.9
4LIV12HP230V1AO	57	26.6	11.2	21.9	12.2	17.9
4LIV18HP230V1AO	72	29.3	11.8	21.9	13.1	20.2
4LIV24HP230V1AO	97	35.0	13.4	26.0	14.6	22.4
4LIV30HP230V1AO	113	36.3	14.5	29.4	15.6	24.0
4LIV36HP230V1AO	127	36.3	14.5	29.4	15.6	24.0

Installation Requirements Roof Stand Strapping Support Angle Design Check: Nomnal / Reqd ≥ 1.00 = OK of Re A-1 2 1/4 A-4 Yes, 2 22ga 1.39 2.18 4.19 A-1 1/4 A-4 22ga 1.39 2.18 4.19 2 Yes, 2 2 A-4 4.18 A-1 1/4 Yes, 2 22ga 1.39 2.18 A-1 1/4 22ga 1.39 4.19 2 A-4 Yes, 2 2.18 A-1 2 1/4 A-4 Yes, 2 22ga 1.25 1.97 4.00 2 1/4 A-4 A-2 Yes, 2 22ga 1.18 2.55 2.70 A-3 1/4 A-4 3.91 2.20 2 Yes, 2 20ga 1.45 A-3 2 1/4 A-4 Yes, 2 20ga 1.45 3.91 2.21

CODE: FMC and FBC 7th Ed. (2020) BLDG, ASCE 7-16

MIAMI-DADE WIND SPEED = 195 MPH (Risk Cat. IV

- Anchor Type is the minimum, h igher strength types permitted.

GENERAL NOTES:

- 1. THIS ENGINEERING REPORT DOCUMENTS THE ANALYSIS OF AC EQUIPMENT MOUNTED ON A ROOF STAND AND THE ASSOCIATED ANCHORING SYSTEMS TO RESIST DEAD WEIGHT AND WIND LOAD FORCES.
- 2. THE LOAD PATH VERIFIED IS FROM THE EQUIPMENT AS A SINGLE UNIT, ENCLOSURE FASTENERS, UNIT LEG ANCHORS, ROOF STAND CROSS SUPPORT TO ROOF STAND TO CONCRETE SLAB
- 3. THE AC UNIT IS MOUNTED ON A METAL ROOF STAND WHICH IS SECURED TO A ROOF CONCRETE SLAB
- 4. ANCHORS USED TO FASTEN THE UNIT TO THE ROOF STAND ARE A307 OR HIGHER STRENGTH STEEL BOLTS.
- 5. THE ROOF STAND IS SUPPLIED BY THE MANUFACTURER INDICATED IN THIS DOCUMENT AND IS INSTALLED IN CONFORMANCE WITH THE ENGINEERING DOCUMENT REFERENCED. 6. UNIT INTEGRITY. IF NOT DESIGNATED BY THE MANUFACTURER FOR THE STATED WIND PRESSURES, IS ADDRESSED BY STRAPPING ATTACHED TO THE UNIT AND ANCHORED TO THE SUPPORT ANGLES. THIS RESISTS SHELL AND FRAME SEPARATION.

CALCULATIONS:

- 1. THE WIND LOAD ACTING NORMAL TO THE LARGE VERTICAL SIDE OF THE AC UNIT IS USED FOR WORST CASE SHEAR.
- 2. THE WIND LOAD ACTING ON THE TOP OF THE UNIT UPWARD AND THE HORIZONTAL WIND LOAD IS USED TO CALCULATE UPLIFT AND MOMENT.
- 3. THESE FORCES MUST BE RESISTED BY THE SHEAR AND TENSILE STRENGTH OF THE ANCHORS BOTH HOLDING THE UNIT TO THE SUPPORT BAR AND THE SUPPORT BAR TO THE ROOF STAND
- 4. THE MOMENT AND SHEAR MUST BE TRANSFERRED FROM THE AC UNIT TO THE ROOF STAND BY A SUPPORT BAR AS THE AC UNIT DEPTH IS LESS THAN THE ROOF STAND DEPTH. 5. MAX MOMENT AND SHEAR TO THE SUPPORT BAR DETERMINE SELECTION OF THE SUPPORT BAR.


ROOF STAND NOTES:


1) ROOF STAND IS BASED ON A DESIGN BY R.M. ENTERPRISES, PER ENGINEERING DRWG DATED 03-09-2012 SIGNED AND SEALED BY P.E.#56902, BUT VERIFIED BY BRI-KO ENGINEERING 2) STHT = STAND HEIGHT WITH MIN 18", MAX 33". 3) STWD = STAND WIDTH = 24" MIN, 36" MAX. 4) STDP = STAND DEPTH = 28" MIN, 36" MAX. 5) SUPPORT ANGLE AND FASTENERS OF SUPPORT TO STAND AND SUPPORT TO AC UNIT ARE DEFINED IN DETAIL BELOW


6) AC UNIT MUST BE CENTERED ON SUPPORT.W.

ROOF STAND LIMITS.) MAX COMPRESSION PER FOOT = 6000 LBS. MAX UPLIFT PER FOOT = 5860 LBS. MAX SHEAR PER TWO FEET = 1700 LBS.

Sheet:	TNC 1	BRI-KO ENGINEERING INC	Cert. Of Auth.:#27622 tel: 954.648.6218		
	ENG-1		This item has been digitally signed and		
Doc:	Page 1 of 1		sealed by Brian I Schwartz on the date		
Gree -4LIV Roof Stand			adjacent to the seal. Printed copies of		
Issue Date: 2-Mar-23			this document are not considered signed and sealed and the signature		
Dwn By:	B.S.		must be verified on any electronic		
Dwg Size:	11x 17		copies.		



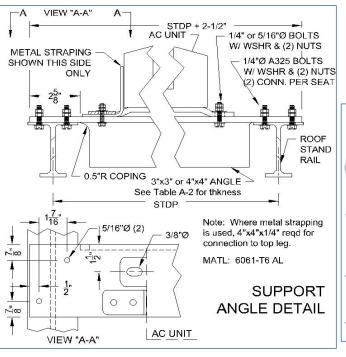



02

POST

യ<u>്</u> 4

UNIT FEET.

1500

TABLE A-1 ANCHOR TYPE AND ALLOWABLE STRENGTHS					
ANCHOR DESCRIPTION &		STRENGTH AT MIN SPACING			
MANUFACTURER	EMBED	PULL OUT (LBS)	SHEAR (LBS)		
1/4" TAPCON (Buildex)	1-3/4"	505	415		
5/16" Hvy Duty Tapcon (Buildex)	1-3/4"	695	760		
3/8" WEDGE BOLT (Powers)	2-1/2"	1025	1370		
1/4" A307 Bolt	N/A	1700	900		

2500

Note: Anchors A-1, A-2, A-3 are into 3000 psi min concrete, 4" thick min.

TABLE A-1 ANCHOR